


Science challenges in modelling of geomagnetically induced currents

Ari Viljanen
Finnish Meteorological Institute
ari.viljanen@fmi.fi

- General modelling scheme
- 3D versus 1D ground conductivity
- Unpredictable ionosphere
- Have we already seen the (Nordic) Carrington storm?

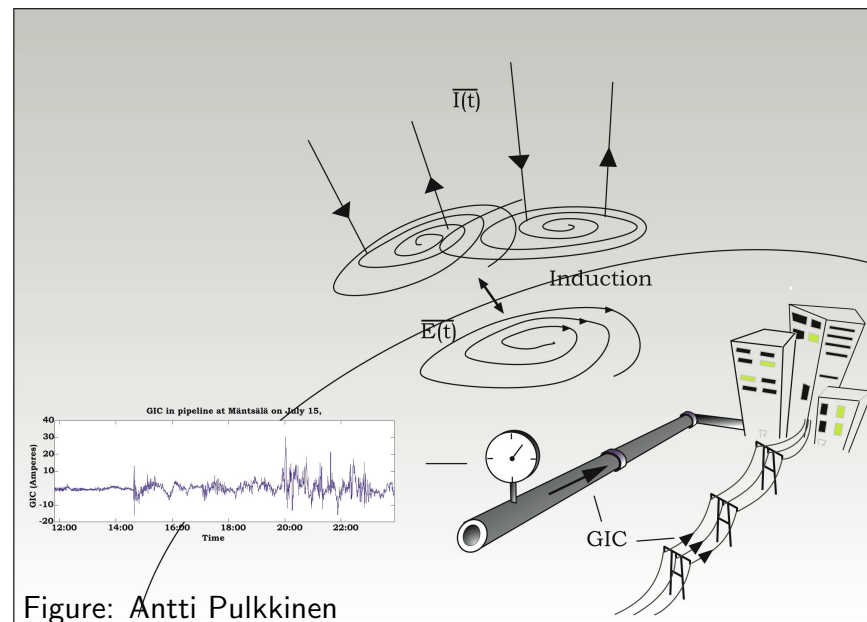

General modelling scheme

$$\nabla \cdot \mathbf{E} = \rho / \epsilon_0$$

$$\nabla \cdot \mathbf{B} = 0$$

$$\nabla \times \mathbf{E} = - \frac{\partial \mathbf{B}}{\partial t}$$

$$\nabla \times \mathbf{B} = \mu_0 \mathbf{J} + \mu_0 \epsilon_0 \frac{\partial \mathbf{E}}{\partial t}$$

$$\mathbf{I}^e = (U + \mathbf{Y}^n \mathbf{Z}^e)^{-1} \mathbf{J}^e$$

$$I_{ij}^n R_{ij}^n = V_{ij} + \sum_{k,l} J_l^e (Z_{ik}^e - Z_{jk}^e) [(U + \mathbf{Y}^n \mathbf{Z}^e)^{-1}]_{kl}$$

Geophysical step

1) Measured (or simulated) magnetic field on the ground

2) Ground conductivity model

→ Horizontal **electric field** on the ground

3) Quasi-DC description of the power grid



→ Solve Ohm's law for currents driven by the electric field in transmission lines and transformer groundings

(Engineering and societal steps)

(Analysis of effects, countermeasures, mitigation measures, preparedness, ...)

Very large grids are manageable.

France 400/225/150/90/63 kV: 3480 substations, 4463 lines.

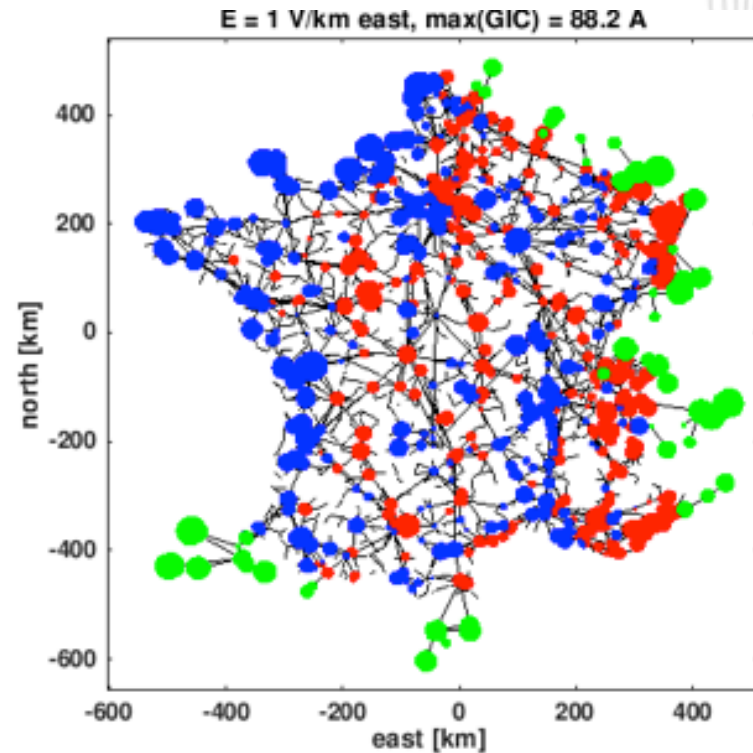
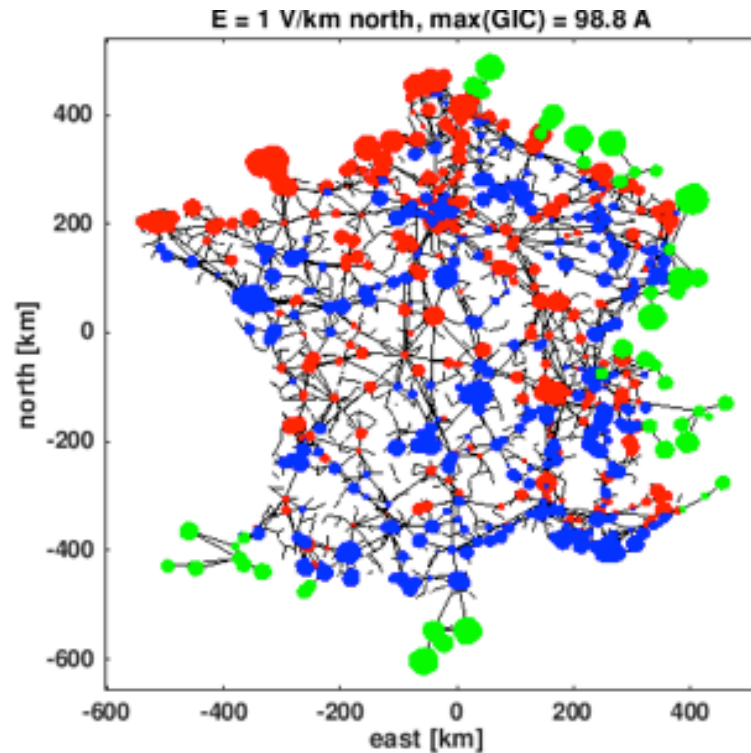


Data sources: RTE Open Data, RTE Static Grid Model

BGS project NEE6840R, funded by EDF Energy R&D UK Centre

16th European Space Weather Week, Liège, Belgium, 18-22 Nov 2019

3D versus 1D ground conductivity

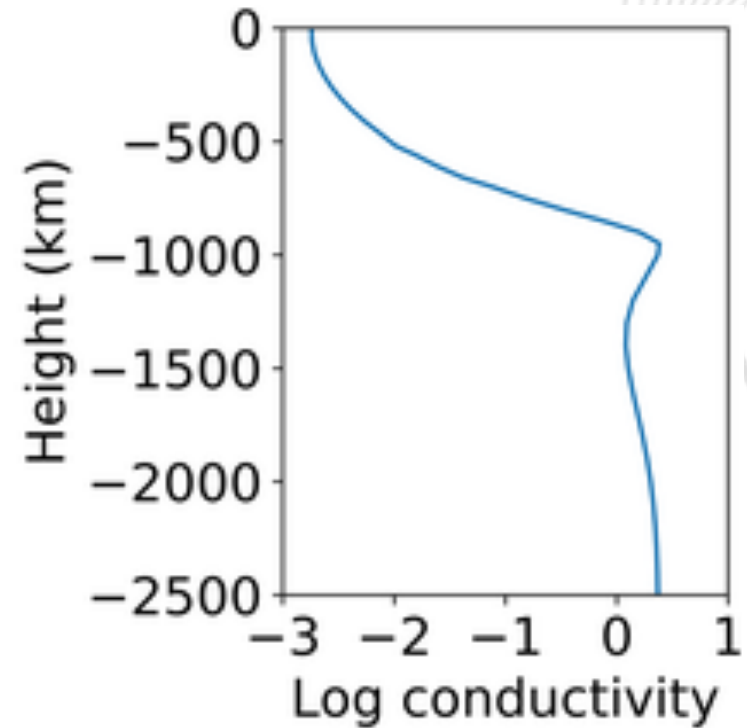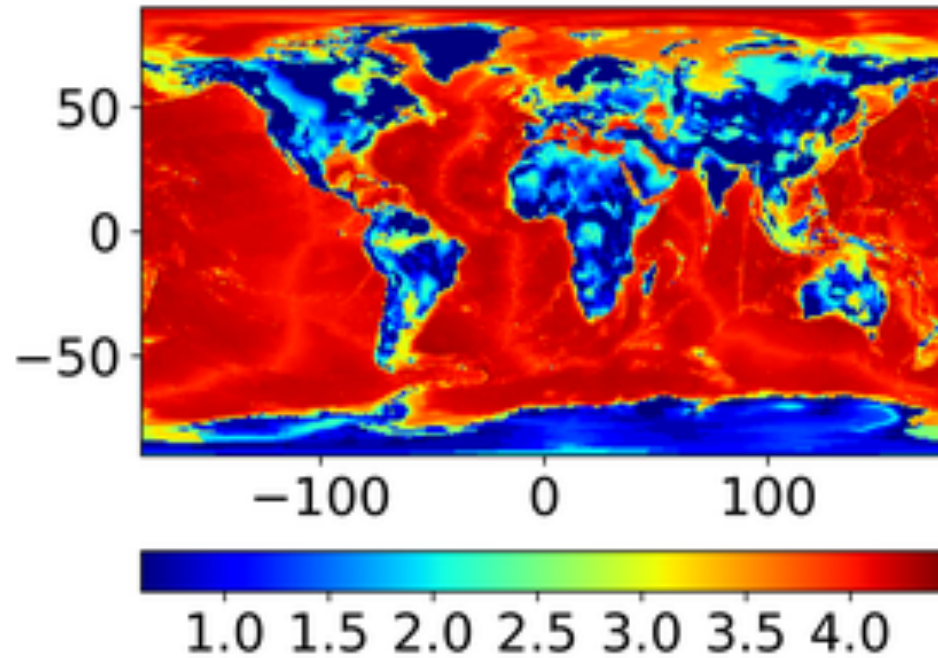


Balancing between accuracy and feasibility.

Figures: *Honkonen et al. (2018)*

Spherical Elementary Current Systems (SECS) + 1D ground conductivity

Geoelectric Field Map Experimental Prototype V1

2019/08/05 09:26:30UTC

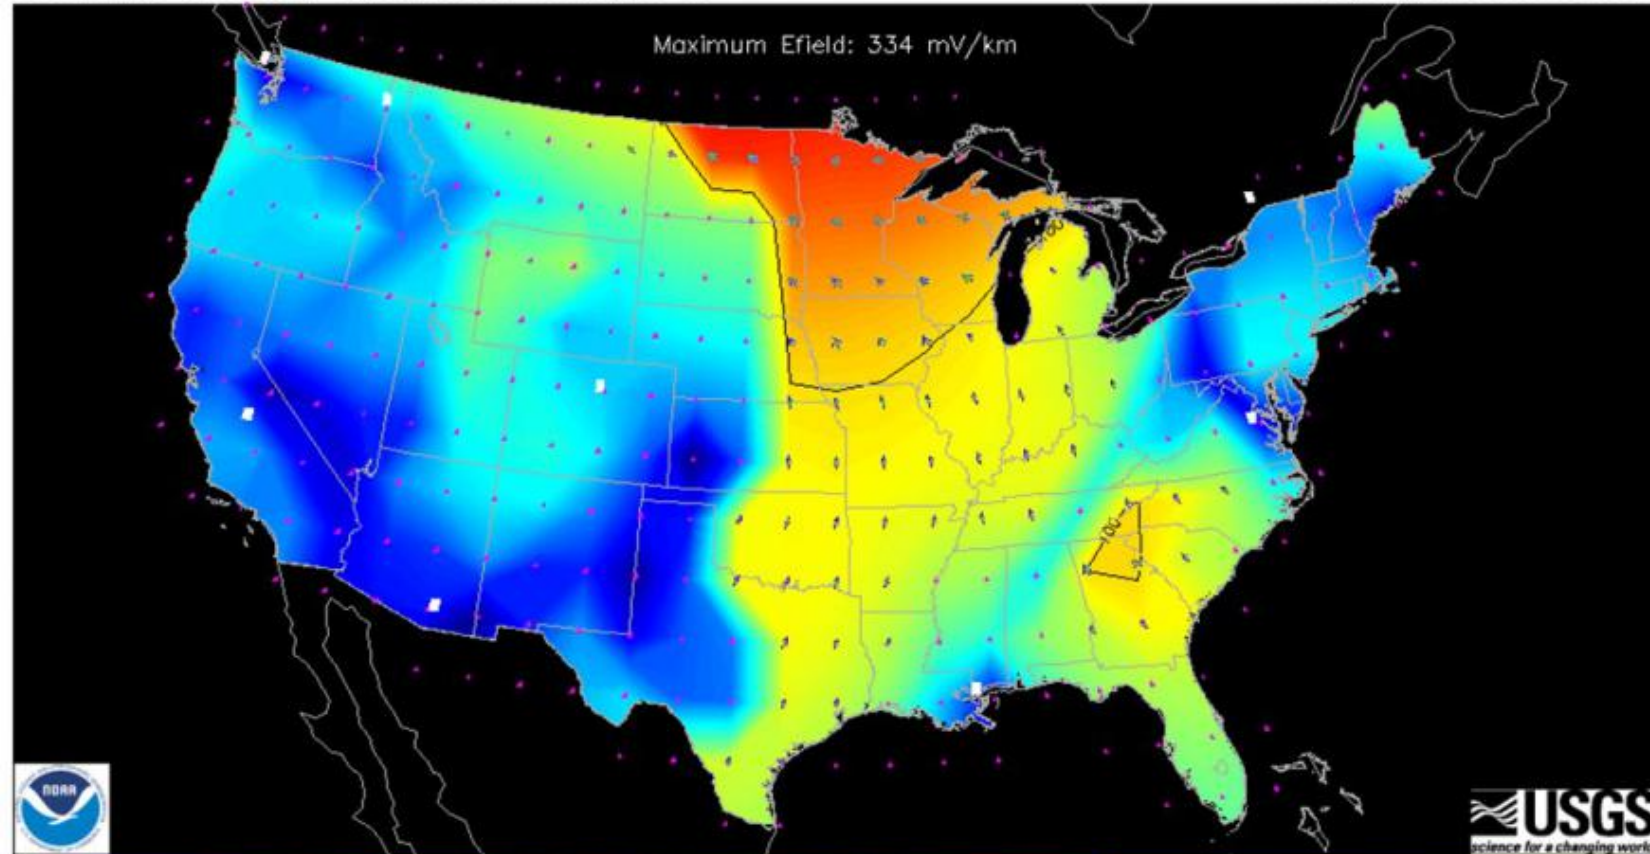

1 10 100 1000 10000
Intensity Scale (mV/km)

Geomagnetic Data provided courtesy of USGS & NRCAN
This map is an experimental prototype for R&D purposes only
One-minute averaged values - 2 x 2 degree grid
Map Creation Time: 2019-08-05T09:37:20.128UTC

Interpolation method - SECS
1D Physiographic Conductivities
Number of Stations Reporting: 12

SECS + 1D ground is a powerful combination.

However, it cannot take into account effects of the true 3D conductivity.

Options to overcome this shortage:

- Empirical MT impedances (*Kelbert et al.*, 2017).
Whenever available, as fast as 1D. No explicit ground model needed.

$$\begin{bmatrix} E_x \\ E_y \end{bmatrix} = \frac{1}{\mu_0} \begin{bmatrix} Z_{xx} & Z_{xy} \\ Z_{yx} & Z_{yy} \end{bmatrix} \begin{bmatrix} B_x \\ B_y \end{bmatrix}$$

- First-principles modelling: Primary magnetic field and ground conductivity given. Precise approach, but can be time-consuming (*Honkonen et al.*, 2018; *Rosenqvist and Hall*, 2019). Facilitates understanding of physics.

3D versus 1D in different scales: $\mathbf{E}(\mathbf{r})$, voltage in a single line, GIC in a full grid.

Unpredictable ionosphere

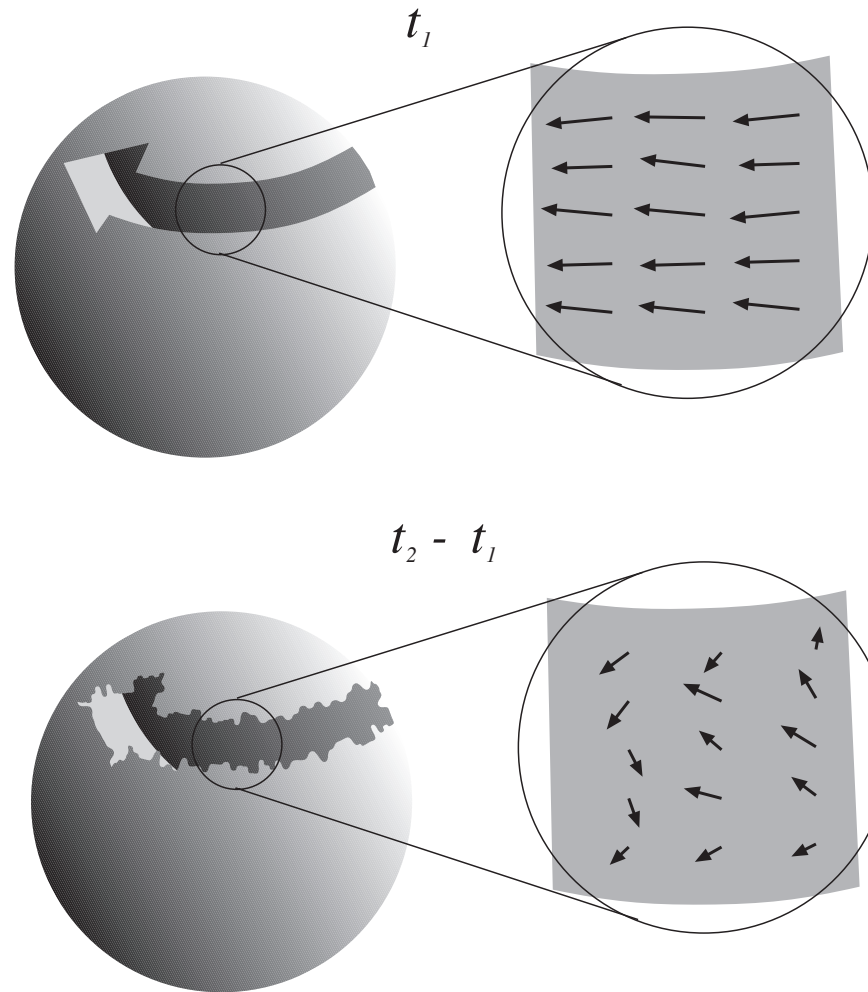



Figure: Antti Pulkkinen

Predicting $d\mathbf{B}(\mathbf{r}, \mathbf{t})/dt$ (magnitude and direction) precisely may be impossible.

Try something empirical (*Wintoft et al., 2015*):


Use solar wind data as input and predict maximum $|d\mathbf{B}/dt|$ within the next 30 min.

Given a ground conductivity model, we get an estimate for maximum $|\mathbf{E}|$ too.

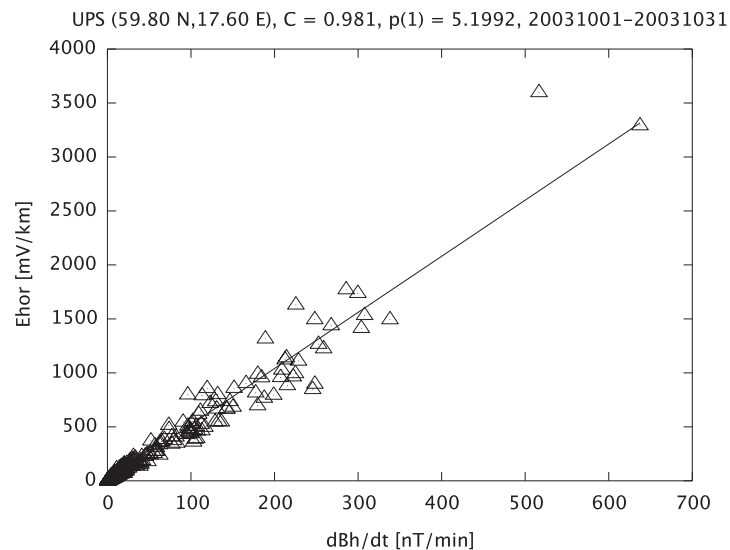


How much does $|\mathbf{E}|$ tell about GIC?

Two cases with an equal regional average of $|\mathbf{E}|$ (1 V/km),
sum of GIC 1164 A and 481 A (*Viljanen and Pirjola, 2017*).

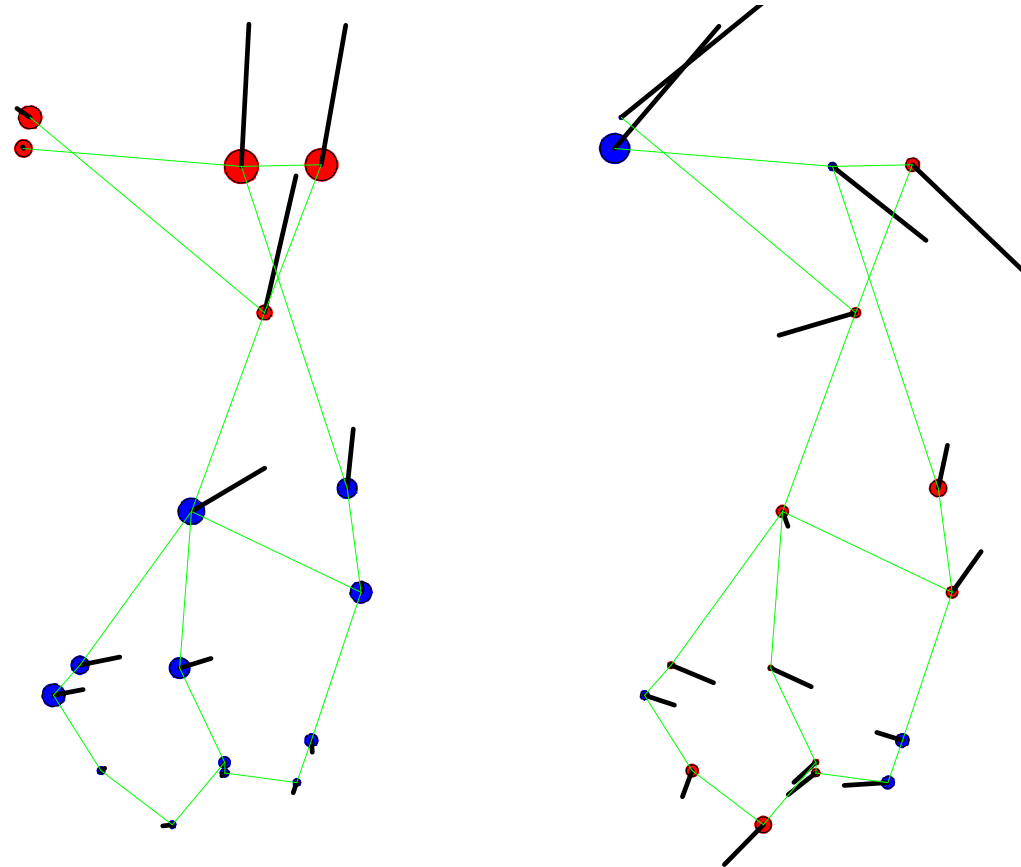

→ Without vector \mathbf{E} , always some uncertainty


There was a Nordic Carrington storm in the 20th century (1-in-100 year event - ground B, dB/dt, E)

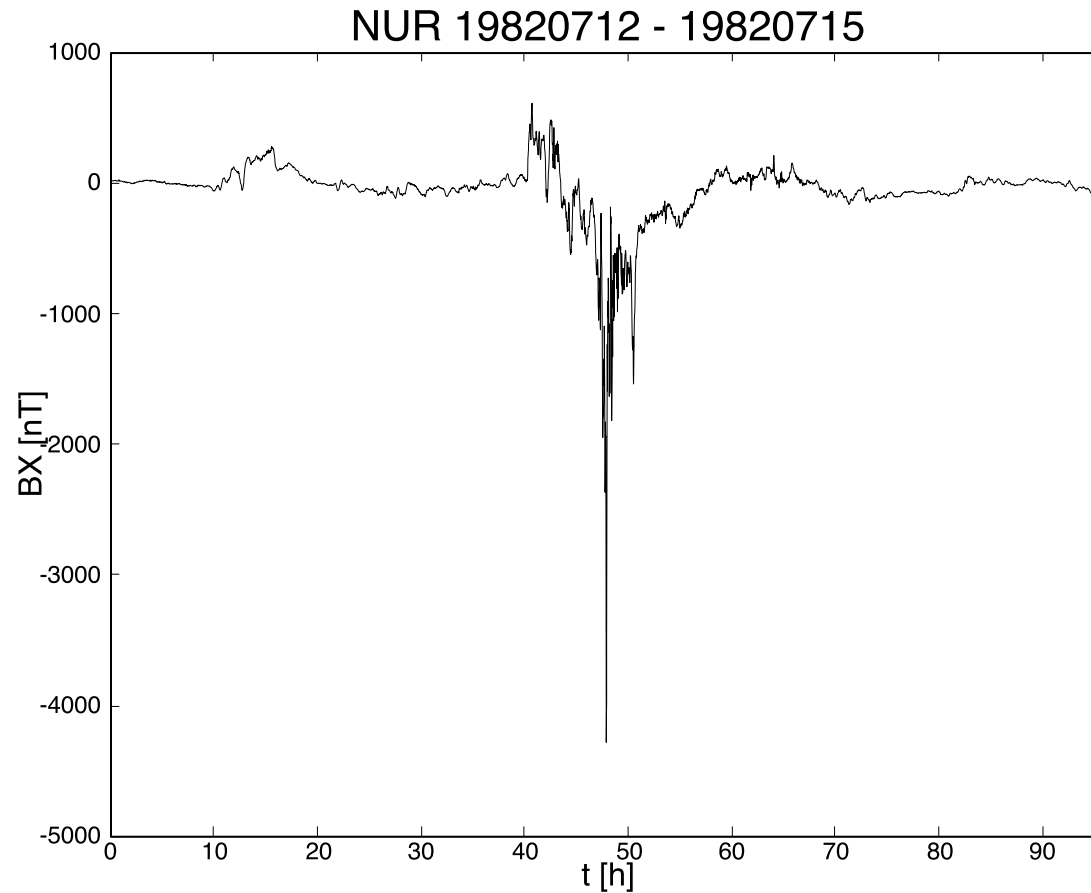

How big is the 1-in-100 year event?


Empirical approach: time series of B , dB/dt or (modelled) E .

Modelled $|\mathbf{E}|$ (Tromsø 1994-2011) extrapolated to 100 years (*Myllys et al., 2014*):

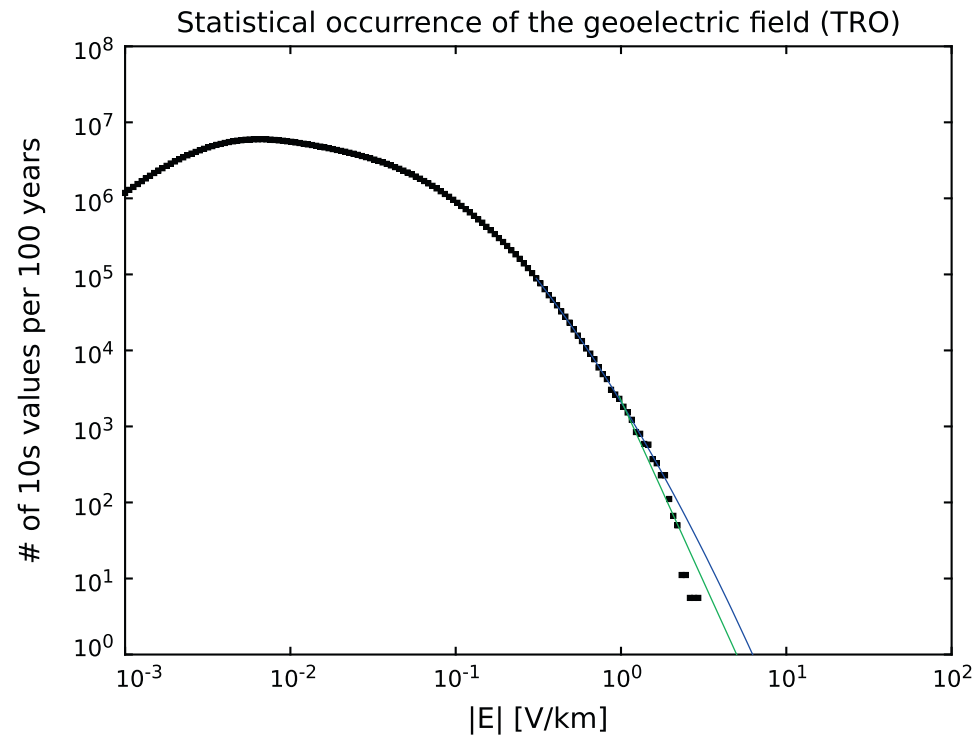

100-year maximum $\approx 2 \times$ maximum value in 1994-2011.


Wintoft et al. (2016): European observatories (up to 32 years of data)
 → At high latitudes, not much bigger variations expected than already seen

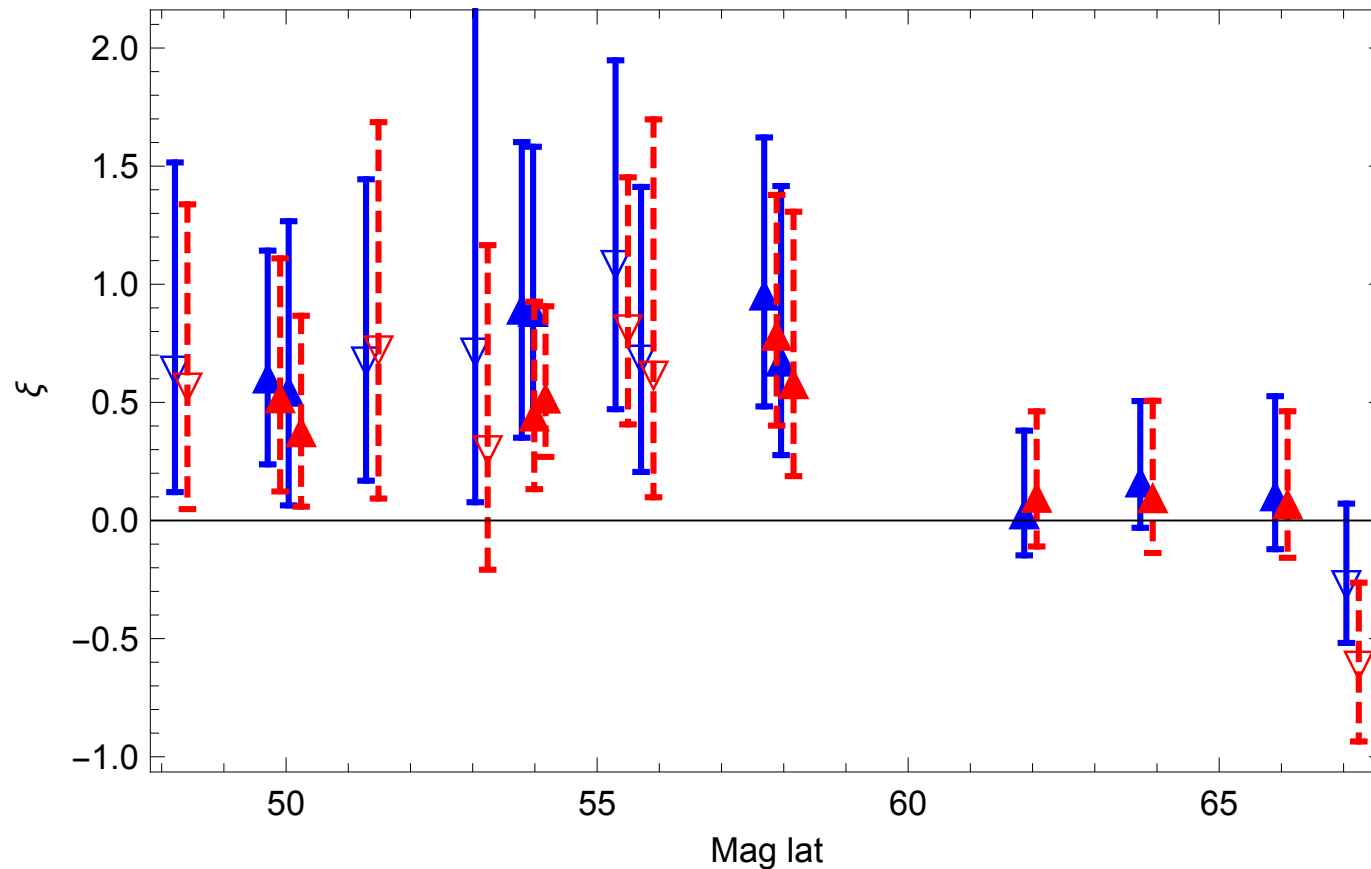

For negative ξ , maximum $|d\mathbf{B}/dt|$ and $|\mathbf{E}|$ have upper limits.


Nikitina et al. (2016): Canadian magnetometers

→ 1-in-100 year event $\sim 20\%$ larger than maximum observed within ~ 40 years

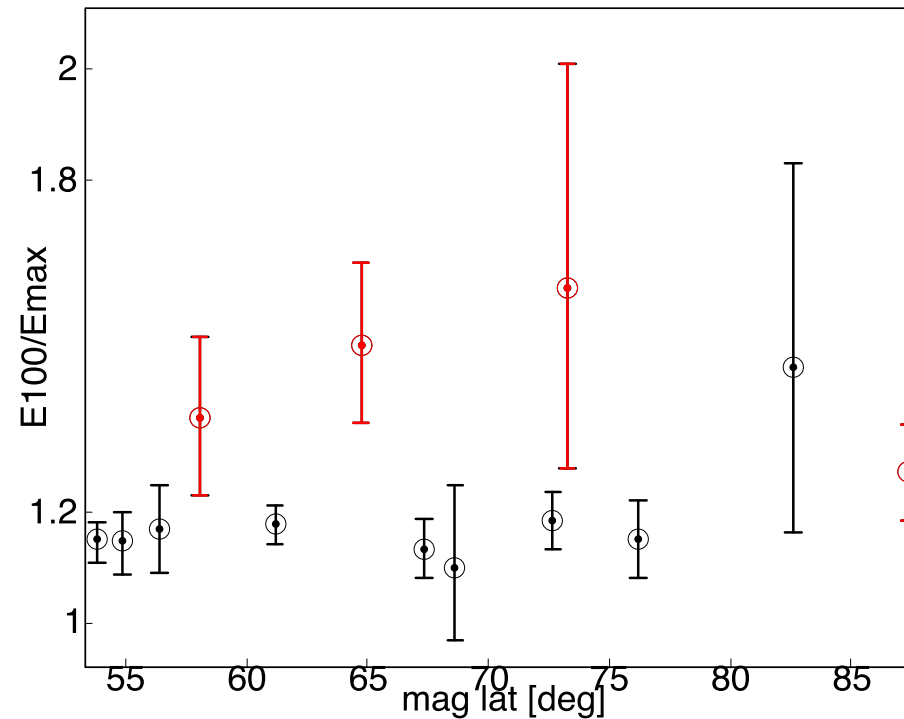

Estimated 1-in-100 year $|\mathbf{E}|$ normalised by the maximum value modelled from geomagnetic data in Canada. Red: less than 39 years of magnetic data available (coverage 17-31 years). Derived from *Nikitina et al.* (2016, supporting information, table S3).

max(E): 1994-2011, E: 1-in-100y, max(E): 13-14 July 1982

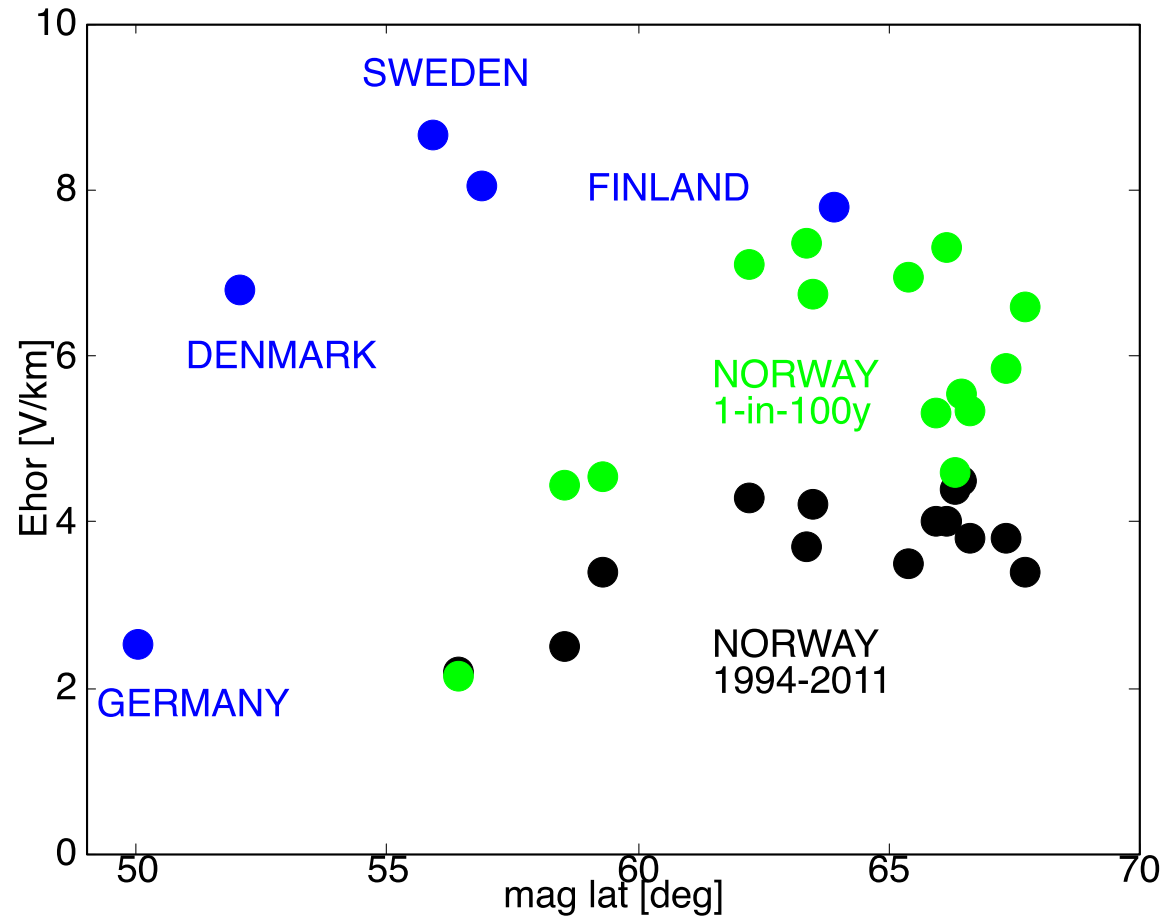

Minor impacts in Sweden: 4 high-voltage transformers and 15 lines tripped.

Conclusions (opinions)

- Basic modelling of past events well-established.
Goelectric field ($\mathbf{E}(\mathbf{r}, t)$) is the key quantity.
- Use of 3D ground conductivity models will gradually become the standard.
- Predicting future events provides some work: simulations, empirical methods.
Much more physical understanding still needed.
- The Nordic Carrington storm occurred (at least) on 13-14 July 1982.
However, no global Carrington events since 1859 (if not May 1921?).

References

Honkonen et al. (2018), doi:10.1029/2018SW001859

Kelbert et al. (2017), doi:10.1002/2017SW001594

Myllys et al. (2014), doi:10.1051/swsc/2014007

Nikitina et al. (2016), doi:10.1002/2016SW001386

Rosenqvist and Hall (2019), doi:10.1029/2018SW002084

Viljanen and Pirjola (2017), doi:10.1051/swsc/2017024

Wintoft et al. (2015), doi:10.1051/swsc/2015008

Wintoft et al. (2016), doi:10.5194/angeo-34-485-2016

Acknowledgements to

Fingrid Oyj and Gasum Oy

Academy of Finland grant 314670